


1/4

Fig. 1

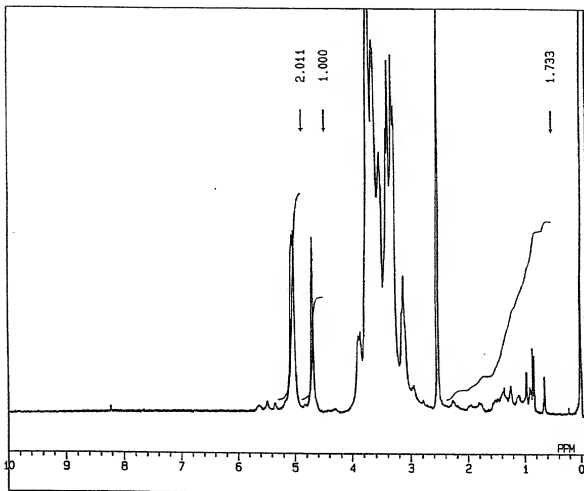

2/4

R.I./a.u.

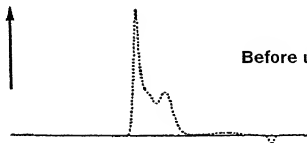


Fig. 2 (a)

Before ultrasonication

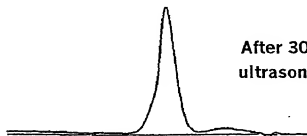


Fig. 2 (b)

After 30 minutes'  
ultrasonication




Fig. 2 (c)

Supernatant

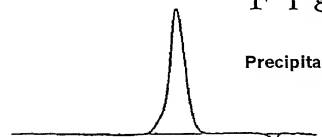


Fig. 2 (d)


Precipitate

0 5 10 15 20 25 30

Elution time (min.)

3/4

F i g. 3

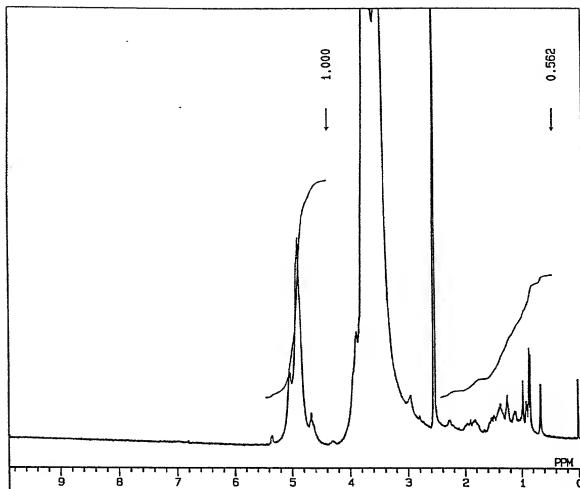

4/4

Fig. 4

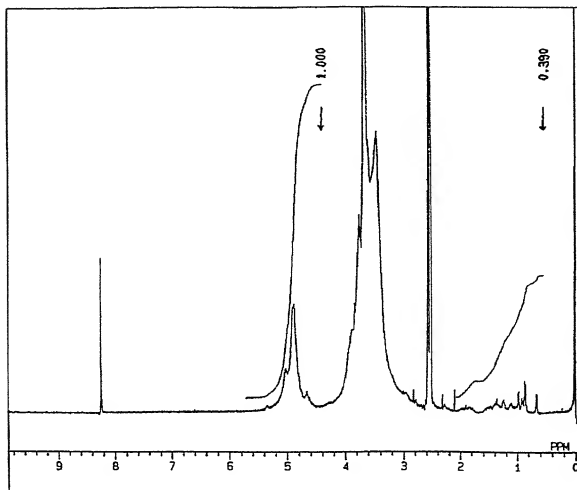


Fig. 5

